


1/2"Ø ANCHOR BOLTS
 W/ 2X2X³/₁₆ STL PL
 WASHER @ 4'-0" O.C.
 MAX AND WITHIN 1'-0"
 OF ALL SILL PLATE
 ENDS AND SPLICES, 7"
 MIN EMBED

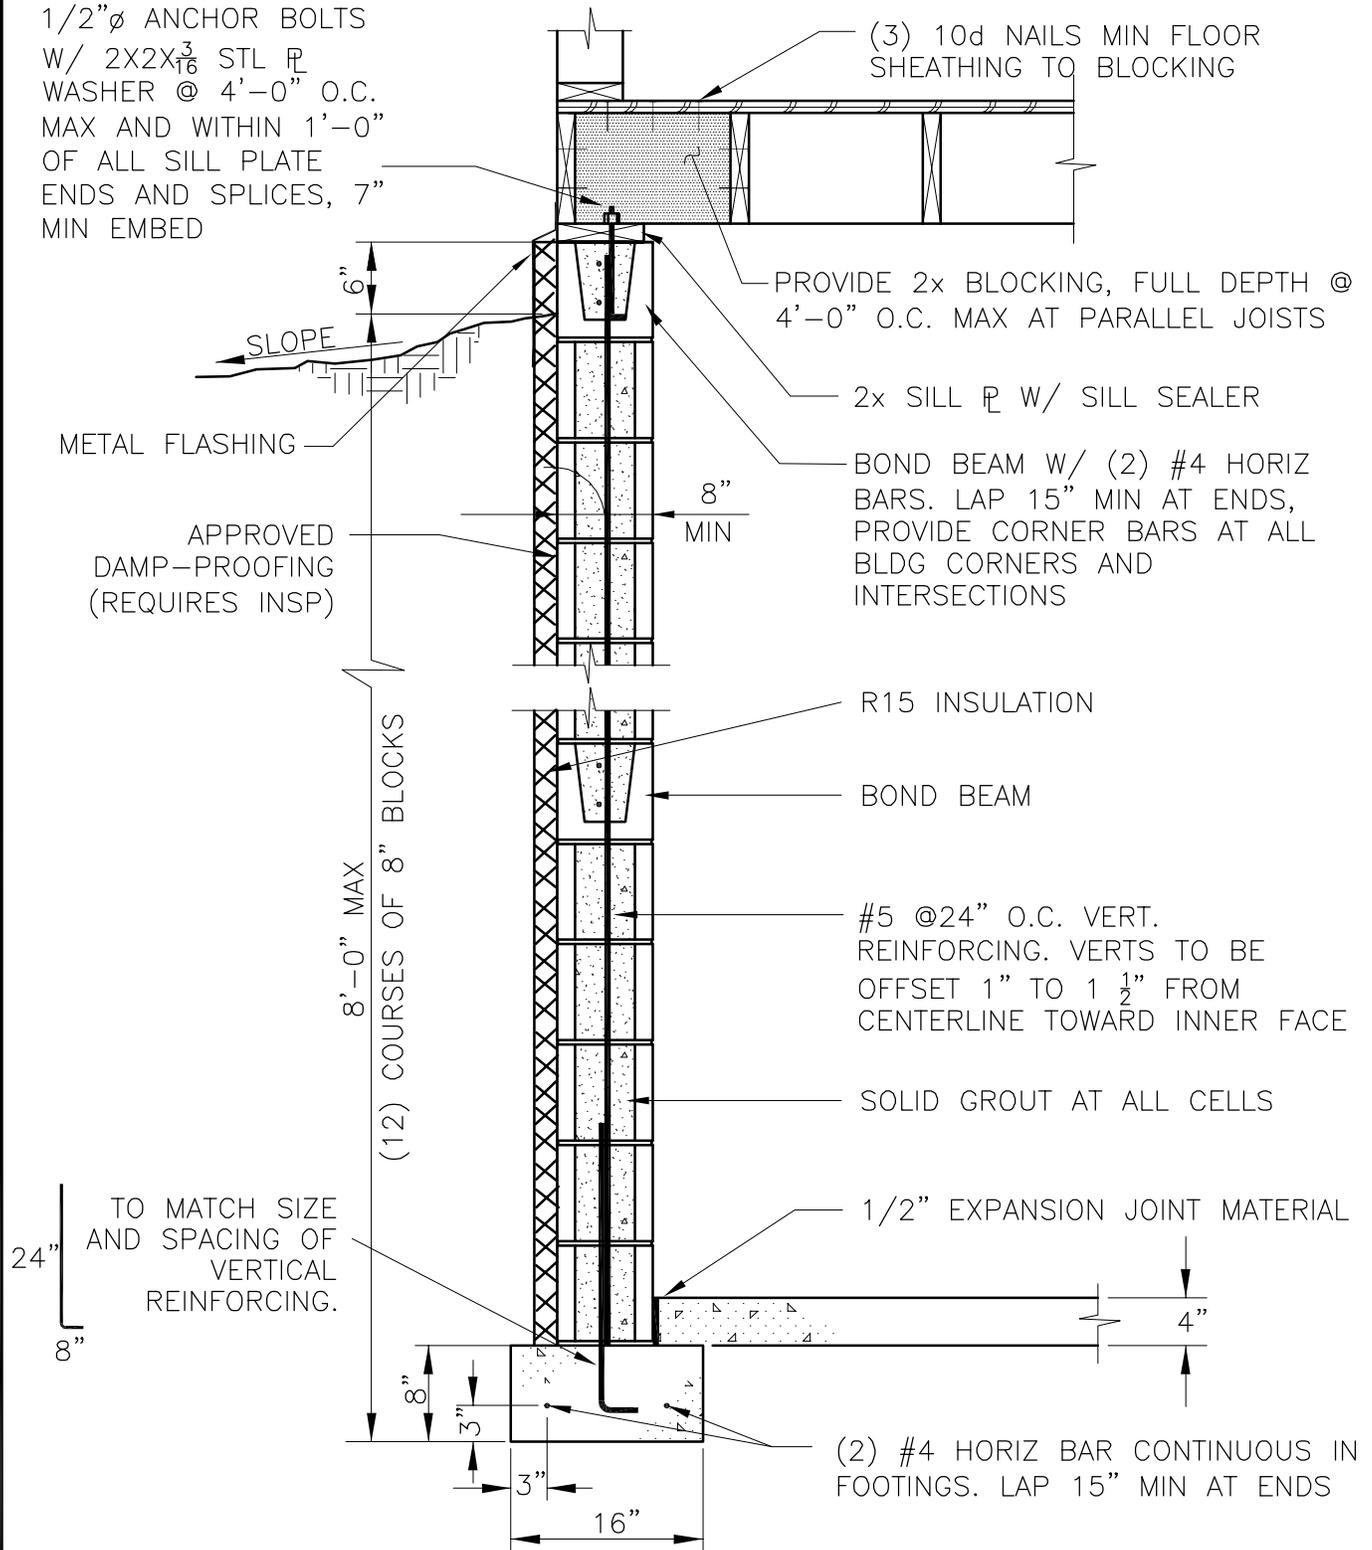

NOTES:

1. VERIFY THAT INSPECTION REQUIREMENTS HAVE BEEN MET BEFORE PLACING ANY CONCRETE.
2. DESIGN ASSUMPTIONS: RESIDENTIAL, MAXIMUM OF 2 FLOORS AND 32' BUILDING WIDTH. USE COMPACTED NFS GRAVEL BACKFILL WITH 2000 PSF BEARING CAPACITY, (SEE IRC SECTIONS R403 & 404).
3. CONCRETE AND GROUT: 2500 PSI MINIMUM COMPRESSIVE STRENGTH.
4. REBAR MINIMUMS: GRADE 40, 30 BAR DIAMETER LAP SPLICES.
5. PROVIDE ADEQUATE WALL BRACING BEFORE PLACING BACKFILL.
6. ANCHOR BOLT SPACING AT SILL PLATE MAY BE INCREASED TO A MAXIMUM OF 6'-0" O.C. FOR A SINGLE STORY RESIDENCE.

FULL BASEMENT - CONCRETE BLOCK	
SFD-7	